

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

DATE ISSUE:20 October 2026

CLOSING DATE: **04 November 2026**

PLACE OF DELIVERY: **Magalies water Vaalkop plant**

For More information/query email quotationswest@magalieswater.co.za



Item No.	Description/Specification	Quantity
	Plant 4 HLPS Pump 3 Supply and install new DN 400 PN 40 Replacement Plunger Valve with gearbox x 1 as per below specification Supply and install DN 600 PN 40 Replacement gate valve x 1 as per below specification Mandatory requirement. 1. ME CIDB grading (at least 1 ME) NB: The quotation should be accompanied by the above requirement. failure to do so will result in the bidder being disqualified	2

Requesting Office: Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers: 014 597 4636	
Facsimile: N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

PN40

DN	400
D [mm]	660
D1 [mm]	250
D2 [mm]	41
B ³ [mm]	48
e1 [mm]	200
e2 [mm]	470
e3 [mm]	420
K [mm]	585
L ¹ [mm]	600
Holes [nr]	16
Weight ² [kg]	435

DIMENSIONS AND WEIGHTS

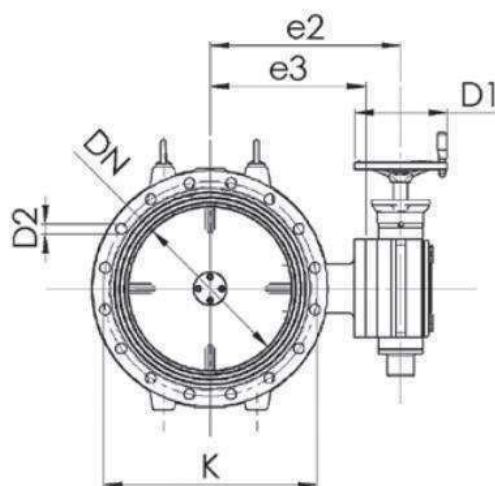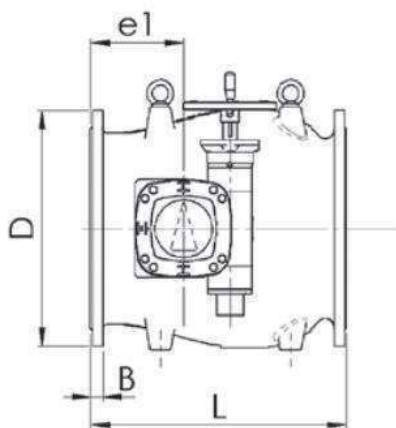


Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

NB: Parts should be made in high corrosion-resistant materials:

- Piston, seat ring, and seal retaining ring made of 1.4401 EN 10088-3 (AISI 316) or 1.4404 EN 10088-3 (AISI 316L) stainless steel
- Rod-link mechanism made of 1.4462 EN 10088-3 DUPLEX 2205 stainless steel.
- Screws, washers, and nuts made of A4-70 EN ISO 3506-1 stainless steel.
- Anti-cavitation cylinder made of 1.4401 EN10088-3 (AISI 316) or 1.4404 EN 10088-3 (AISI 316L) stainless steel.
- Hydraulic test according to EN 1074-5
- The parts in contact with the fluid should be suitable for use with drinking water and SANS certified

COMPONENTS AND MATERIALS

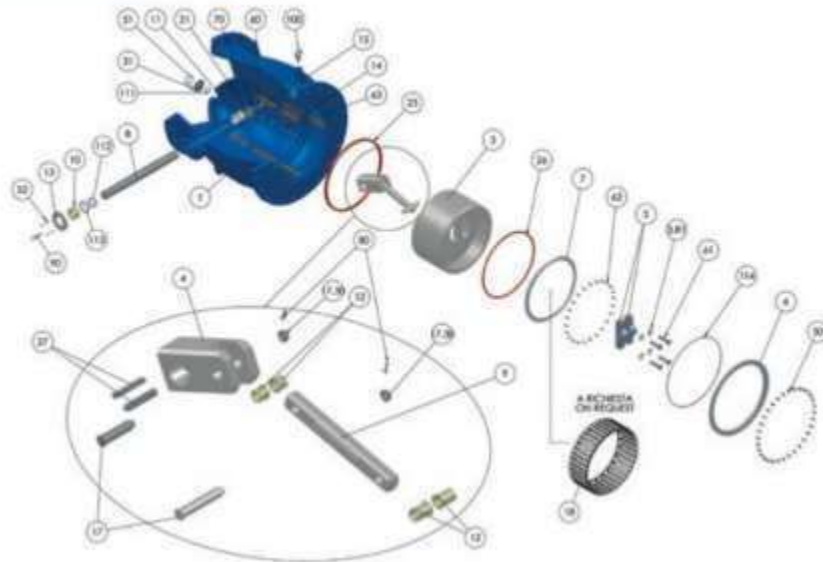

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	
E-mail address: quotationswest@magalieswater.co.za	RFQ – 10026317

ITEM	COMPONENT	MATERIAL	NOTE
1	Body	EN-GJS 500 - 7 EN 1563 (GS 500 - 7)	Epoxy coating 300 µm
	Body (for PN ≥ 40)	EN-GJS 400 - 15 EN 1563 (GS 400 - 15)	Epoxy coating 300 µm
3	Obturator	1.4301 EN 10088-3 (AISI 304) / 1.4306 EN 10088-3 (AISI 304L)	
3.R1	Locking washer	1.4401 EN 10088-3 (AISI 316)	
4	Link (DN200 - DN700)	1.4028 EN 10088-3 (AISI 420 B)	
	Link (DN800 - DN1400)	Structural steel	Epoxy coating 300 µm
5	Fork (DN200 - DN300)	1.4028 EN 10088-3 (AISI 420 B)	
	Bracket-fork (DN350 - DN1400)	1.4028 EN 10088-3 (AISI 420 B) / 1.4462 EN 10088-3 (DUPLEX 2205)	
6	Seating ring	1.4301 EN 10088-3 (AISI 304)	
7	Seal retaining ring	1.4301 EN 10088-3 (AISI 304)	
8	Shaft	1.4028 EN 10088-3 (AISI 420 B)	
9	Connecting rod	1.4028 EN 10088-3 (AISI 420 B)	
10 / 11 / 12	Outer / Inner bearing / Link bearing	CC 333 G EN 1982 CuAl10Fe5Ni5-C (Bronze)	
13	Actuator coupling disk	1.4301 EN 10088-3 (AISI 304)	
14 / 15	Sliding blocks	CW 307 G M EN 12165 (Bronze)	
17	Connecting pins	1.4028 EN 10088-3 (AISI 420 B)	
17.30	Washer for connecting pins	1.4401 EN 10088-3 (AISI 316)	
18	Dissipating cylinder (on request)	1.4301 EN 10088-3 (AISI 304) / 1.4306 EN 10088-3 (AISI 304L)	
21	Stop washer	1.4301 EN 10088-3 (AISI 304)	
23	Lip Seal	N-PU polyurethane elastomer	
26	Main Seal	N-PU polyurethane elastomer	
27	Tongue (internal)	1.4028 EN 10088-3 (AISI 420 B)	
31	Nose cone (DN200 - DN800)	1.4301 EN 10088-3 (AISI 304)	
	Nose cone (DN900 - DN1400)	Polymer POM	
50/51/52/60 61/62/63	Screws	A2-70 EN ISO3506-1	
70	Locking washer	A2-70 EN ISO3506-1	
80	Cotter pins	A2-70 EN ISO3506-1	
90	Tongue	1.0511 EN 10083-2 + QT (C40B)	
10	Eyebolt	Galvanized steel	
110 - 114	O-Ring	EPDM	

DN 600 Gate Valve Specification

Supply DVD Gate Valve with rising stem and top Flange ready for actuator assembly (ISO-5210)

Valve is a bonnet type with raising stem.

Paint Specification: Two Pack Liquid Epoxy Blue

Valve OEM: DVD Valves

Type: Raising Stem Gate Valve

Size: DN 600, Operating Pressure: PN40


Flange to flange (L): 800mm. (Flange Thickness: 50mm)

Flange Diameter: 900mm, PCD: 800mm with 20holes with diameter of 50mm

Flange spec: (EN558-1 Series 15, DIN3202 – F5)

H1: 2250.

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

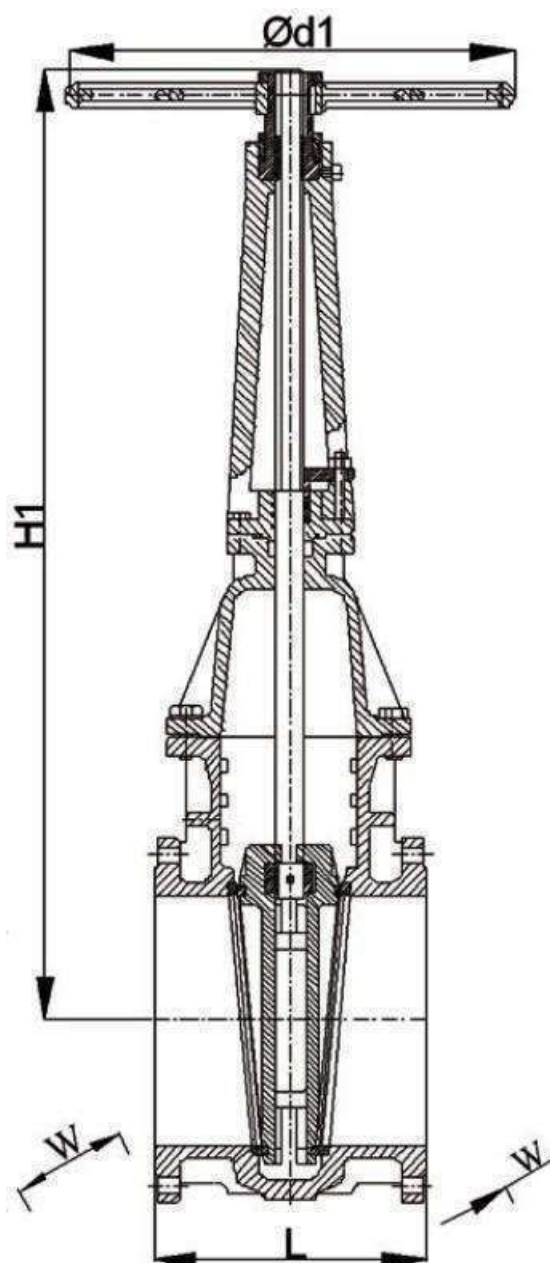

Description and Materials

Body and Bonnet: Ductile Iron GGG40

Wedge: Ductile Iron GGG40

Stem: X20Cr13

Stem Nut, Wedge ring, Yoke Nut, Top Nut and Seat Ring: Bronze

Gasket: Rubber

Screws and Studs: Grade 8.8

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	
Compulsory Briefing Venue : Magalies Water Vaalkop Plant Date : 29 October 2026 Time : 10H00 Contact Aaron Mahada :066 472 0555	

1. Submission of Quotations

RFQ Number must always be stated on the quotation.

Quotations should be submitted on or before the Request for Quotation Deadline **Date by no later than 12h00** to the email below. Email: quotationswest@magalieswater.co.za.

No hand delivered quotations will be accepted, all quotations to be submitted to the email indicated on the RFQ.

2. Selection of Qualifying Quotation

The selection of the qualifying quotation will be at Magalies water's sole discretion. Magalies Water does not bind itself to accept any particular Quotation.

3. Documents required

ADMINISTRATIVE REQUIREMENTS REQUIREMENTS:

- Quotation must have CSD vendor number **or** CSD report
- Quotation must have RFQ reference number
- Completed and signed Declaration of Interest Form (SBD4)
- Quotation with validity period should be a minimum of 30 days or more from the date of issue.
- Quotation with physical address, date, contact details and banking details.

MANDATORY REQUIREMENTS REQUIREMENTS:

- Quotation must be line with the specification.
- Quotations received after the closing date will not be accepted.

***NB All non-responsive bids will be rejected.**

4. EVALUTION OF QUOTATION

All Quotations with a rand value equal to or below R50 million, will be evaluated in terms of the PPR 2022 using the 80:20 Preference point system.

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

CRITERIA	POINTS
Price	80

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

Specific goals	20
TOTAL	100 points

Specific goal	Number of points (80/20 system)	Means of verification
Black people ownership equity	5	Central Supplier Database (CSD) report
Women equity	3	Central Supplier Database (CSD) report
Youth equity	2	Central Supplier Database (CSD) report
Disability	2	Medical certificate or (CSD)
Promotion of small businesses Medium- 2 Points Small- 3 Points Micro- 4 Points Other- 0 Points	4	1. Central Supplier Database (CSD) report for transactions from rand value to R500 000.00. 2. Signed Financial Statements for transactions above R500 000.00
Locality	3	Proof of address (tribal authority letter/ Lease agreement accompanied by municipal rates invoice/statement)
Military Veterans (MVA)	1	MVA force number/CSD
Total	20	

Requesting Office:Magalies water Vaalkop plant	
Contact Person: Selina Maledu	
Contact Numbers:014 597 4636	
Facsimile:N/A	RFQ – 10026317
E-mail address: quotationswest@magalieswater.co.za	

5. TERMS & CONDITIONS

- 5.1. Quotations received after the closing date will not be accepted.
- 5.2. All costs to be included in the quotation.
- 5.3. Delivery must take place at the specified place.
- 5.4. Quotations to be valid for a minimum of 30 days or more from date of issue.
- 5.5. The Government Procurement General Conditions of Contract shall apply.